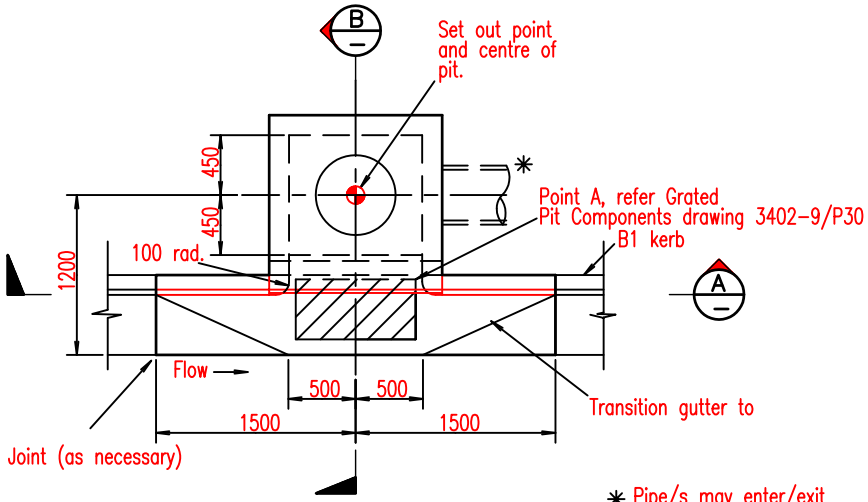

PLAN

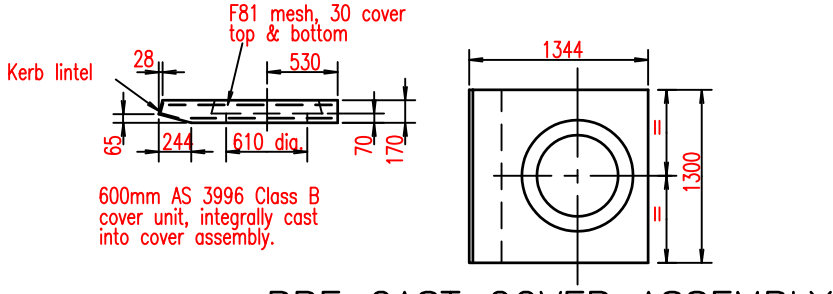

PRE CAST COVER ASSEMBLY

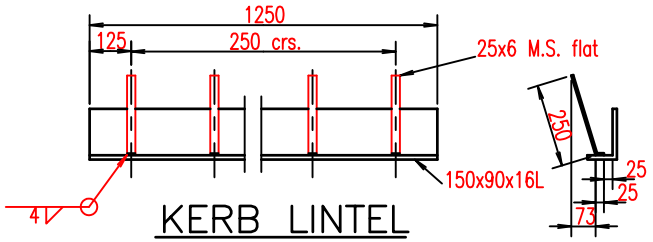

KERB LINTEL

(Galvanise after fabrication)

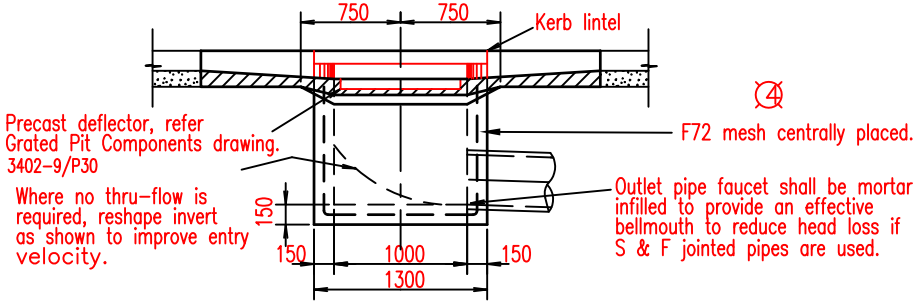

SECTION A

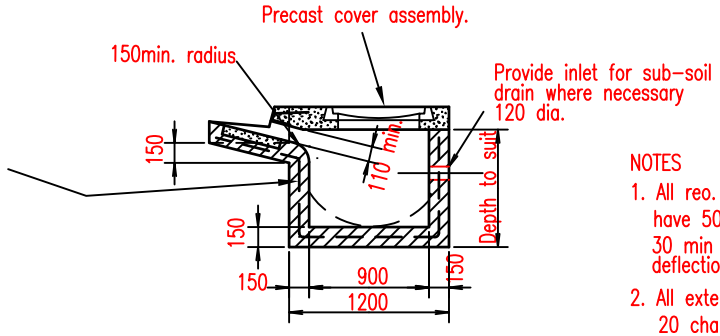

SECTION B

NOTES

1. All reo. to be lapped 300 and to have 50 min. cover. 30 min cover for lid and in vicinity of deflection unit.
2. All external corners to have a 20 chamfer.
3. Grade N25 concrete.
4. Pits deeper than 1200 and less than 2400 to be fitted with step irons. Pits deeper than 2400 to be fitted with ladder.
5. Pit covers to match finished surface slope.

No.	AMENDMENTS	CHECKED	DATE	APPROVED
4	reinforcement requirement amended		15/4/98	JRG

DRAFTING		DESIGN	
DRAWN S.J.J.	DATE DEC91	DESIGNED R.R.W.	DATE DEC91
CHECKED D. PEARCE	DATE	RECOMMENDED/CHECKED	DATE
APPROVED J.R.G.	DATE DEC 91	ACCEPTED R. WILSON	DATE DEC 91

DEPARTMENT OF INFRASTRUCTURE, ENERGY AND RESOURCES, TASMANIA

SIDE ENTRY PIT
BARRIER KERB

FROM LINK No. / DISTANCE	TO LINK No. / DISTANCE
CONTRACT No.	SHEET No.

DRG. No. 3402-9/P25-4