


NOTES:

1. DIMENSION "D" = INTERNAL DIAMETER OF PIPE
2. REINFORCEMENT F81 UNLESS OTHERWISE SPECIFIED SHALL BE CONTINUOUS AROUND CORNERS AND LOCATED AS SHOWN. CLEAR COVER 50 MINIMUM UNLESS NOTED OTHERWISE LAPS 300 MINIMUM
3. CONCRETE CLASS N25
4. EXPOSED EDGES SHALL HAVE 20 x 20 CHAMFERS
5. SLOPE OF ENDWALL TO MATCH BATTER SLOPE.
6. NORMALLY INSTALLED WHEN CULVERT IS PERPENDICULAR TO TRAFFIC.




SECTION A S-1

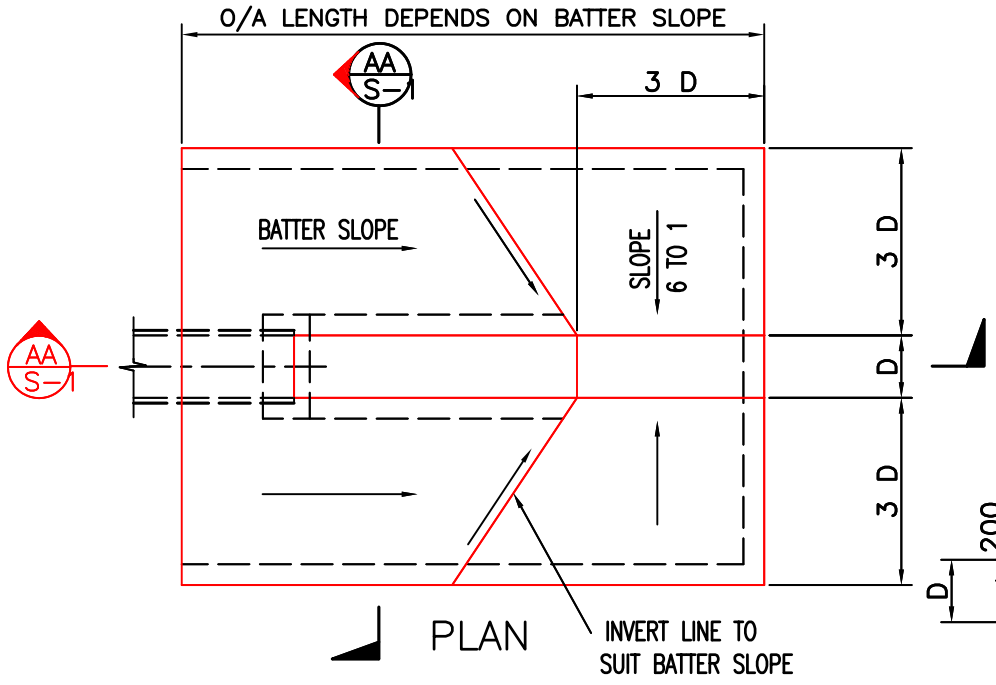


SECTION A S-1

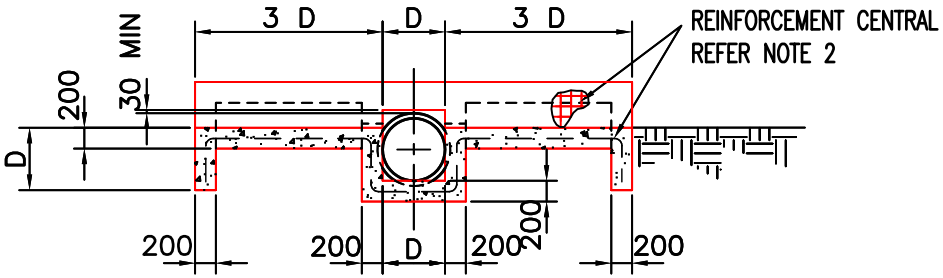


END ELEVATION

NOT TO SCALE
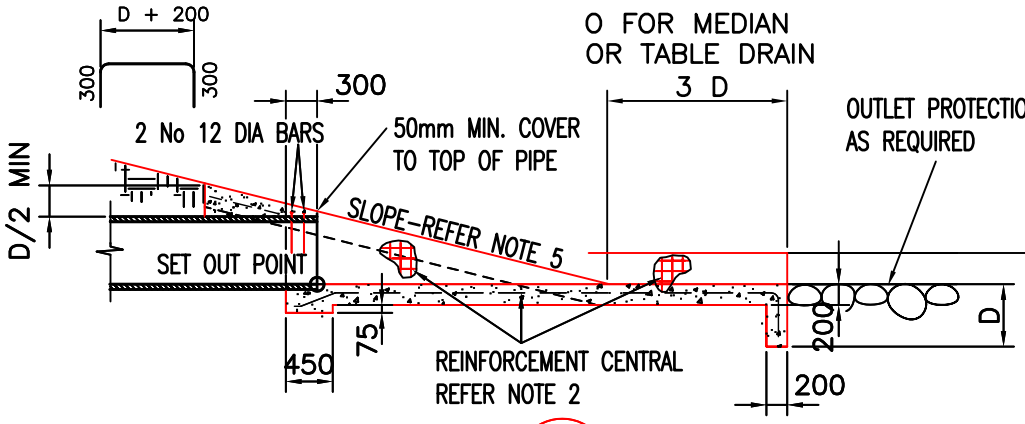
| No. | AMENDMENTS | CHECKED | DATE | APPROVED |
|---|---|---|---|---|
| | NOTE 6 ADDED | | 15/5/02 | G.K.R. |

| DRAFTING | | DESIGN | |
|---|---|---|---|
| DRAWN A.J.W. | DATE 23/2/99 | DESIGNED | DATE |
| CHECKED E. A. PITMAN | DATE 3/9/99 | RECOMMENDED/CHECKED B. J. WILLIAMS | DATE 3/9/99 |
| APPROVED P. HOLLAND | DATE 3/9/99 | ACCEPTED G. K. ROBERTS | DATE 6/9/99 |

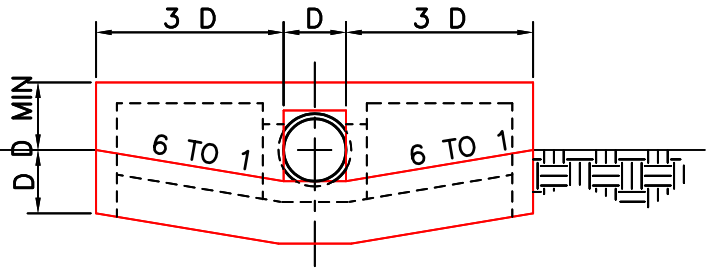DEPARTMENT OF INFRASTRUCTURE, ENERGY AND RESOURCES, TASMANIA

# DRIVEABLE CULVERT ENDWALL

TYPE 2

SINGLE PIPE CULVERT 450 DIA MAXIMUM

| FROM LINK No. / DISTANCE | TO LINK No. / DISTANCE |
|---|---|
| CONTRACT No. | SHEET No. |

DRG. No. 3402-2/P36-1