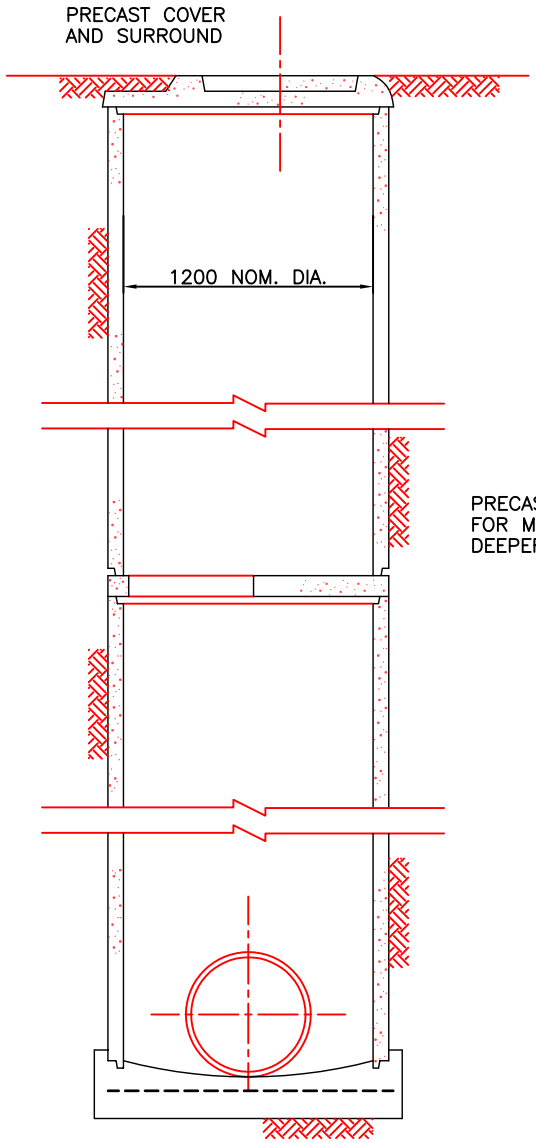

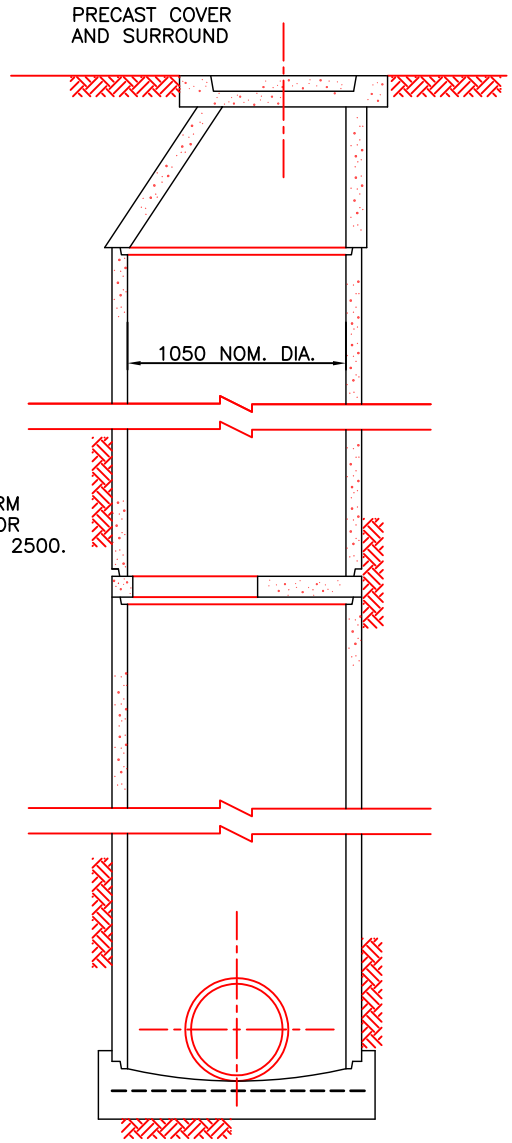

PRECAST REST PLATFORM FOR MANHOLES 6000 OR DEEPER. MAX. SPACING 2500.

PRECAST TAPER UNIT

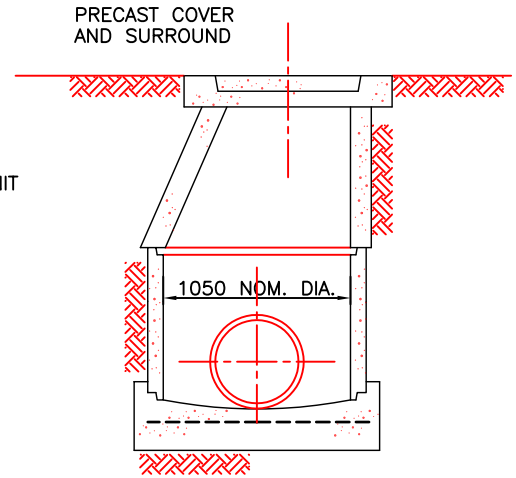

MAX. DEPTH 1200
WITHOUT STEP IRONS

CONNECTING PIPES. (NOM. DIA.)	CHAMBER (NOM. DIA.)
⩽600	1050
>600 ⩽900	1200

NOTES

1. ACCESS PITS DEEPER THAN 1200 AND LESS THAN 2400 TO BE FITTED WITH STEP IRONS. ACCESS PITS DEEPER THAN 2400 TO BE FITTED WITH LADDER.
2. ACCESS PIT BASE TO BE 200 MIN. THICKNESS F81 MESH 75 TOP COVER.
3. COVERS TO BE STRENGTH CLASS B FOR FOOTPATHS AND STRENGTH CLASS C OR D FOR PAVED AREAS.
4. INLET PIPES IN DROP ACCESS PITS MUST ENTER BELOW TAPER UNIT.
5. WHERE ACCESS PIT IS LOCATED IN A CARRIAGEWAY THE PRECAST COVER AND SURROUND SHALL BE REPLACED WITH A HEAVY DUTY TRAFFICABLE UNIT.
6. GRADE N25 CONCRETE.
7. PIT COVER TO MATCH FINISHED SURFACE SLOPE.
8. SET OUT POINT IS AT CENTRE OF CHAMBER.

No.	AMENDMENTS	CHECKED	DATE	APPROVED
5	NOTES AMENDED		7/6/02	GKR

DRAFTING		DESIGN	
DRAWN	DATE	DESIGNED	DATE FEB 85
CHECKED	DATE	RECOMMENDED/CHECKED J. T. ARMSTRONG	DATE 8/5/85
APPROVED	DATE	ACCEPTED W. D. COOMBES	DATE 9/5/85

DEPARTMENT OF INFRASTRUCTURE, ENERGY AND RESOURCES, TASMANIA

ACCESS PIT

FROM LINK No. / DISTANCE	TO LINK No. / DISTANCE
CONTRACT No.	SHEET No.

DRG. No. 3402–9/P23–5